

IMPACT OF THE RENEWABLE ENERGY SOURCES ON LONG-TERM DYNAMIC IN THE SLOVAK POWER SYSTEM

Pavol Hocko, Jaroslav Petráš, Matúš Novák, Ján Zbojovský

ABSTRACT

This paper discuss about long-term dynamics simplified model of the power system. This model represents Slovak power system connected trough inter-tie line to interconnected power system – ENTSO-E. The Slovak power system itself is represented by node SEPS. To this node conventional and renewable energy sources are connected. The significant growth of installed power capacity of renewable energy sources (RES) in the last few years may cause incidental disturbance of power balance in the power system. This problem is typical for photovoltaic power stations. It is very hard to predict photovoltaic (PV) power production especially during cloudy weather conditions. Because of this fact it is very important to determine maximum share of RES in each power system. This paper deals with impact of PV in power system.

1. INTRODUCTION

Until the 30th of June 2011 there were 857 producers of electricity from photovoltaic in Slovakia. This date is also associated with the end of state’s energy purchase price support. The 33 of 857 photovoltaic power plants (PVPP) has installed capacity more than 1 MW. All PVPP are connected to distribution power subsystem. This means that the power system operator can’t controls power production from this sources. All produced energy from RES must be delivered to the power system. However, power system operator (PSO) is required to maintain power system balance and cross-border power balance with other power systems. In this case there is unknown value of power consumption and also power production from RES.

Pursuant to European Union Slovak Republic has to guarantee 14 per cent share of power production from RES on total power consumption in year 2020. In year 2010 advantaged prices of electricity from RES caused more than 18 per cent power production share from RES on total power consumption. Table 1 shows power production share from RES on total power consumption in the period from year 2007 to 2010.

Table 1 - Growth of RES share on total power consumption

Year	2007	2008	2009	2010
Power production from RES (GWh)	5080	5147	5173	5280
Total power consumption (GWh)	29717	29824	27467	28761
RES power production share (%)	17,1	17,3	18,8	18,4

The RES can be divided by type of primary energy source to power production from water, sun, wind, geothermal, biomass and biogas energy. Some of these renewable sources can be in some specific circumstances unpredictable. This phenomenon is most pronounced in energy from sun and wind. Because of the weather conditions photovoltaic and wind power plants may be in some cases highly unpredictable. Installed power in wind power plants is in Slovakia only 3.14 MW. This capacity is negligible and can't influence power balance.

Installed power in PVPP is more than 480 MW. With the 7100 MW of total installed power capacity in Slovak power system, this share is significant and in some cases may greatly influenced power system balance. This may occurs especially in summer, when power production from PVPP is the largest in the year, thus this power share from unpredictable PVPP is largest. Alternately cloudiness cause significant decrease of delivered power from PVPP in the range of tens of percent. The large share of produced power from RES thus can cause instability in the power system.

2. POWER SYSTEM MODEL SIMULATION

Figure 1 shows simplified model of Slovak power system. This model was inspired by the Czech power system model made by Mr. Ing. Karel Máslo. This model includes simplified power system of Slovak Republic (PS SR) synchronously connected to interconnected power system – ENTOS-E. ENTOS-E is modeled as individual control area (marked as green area).

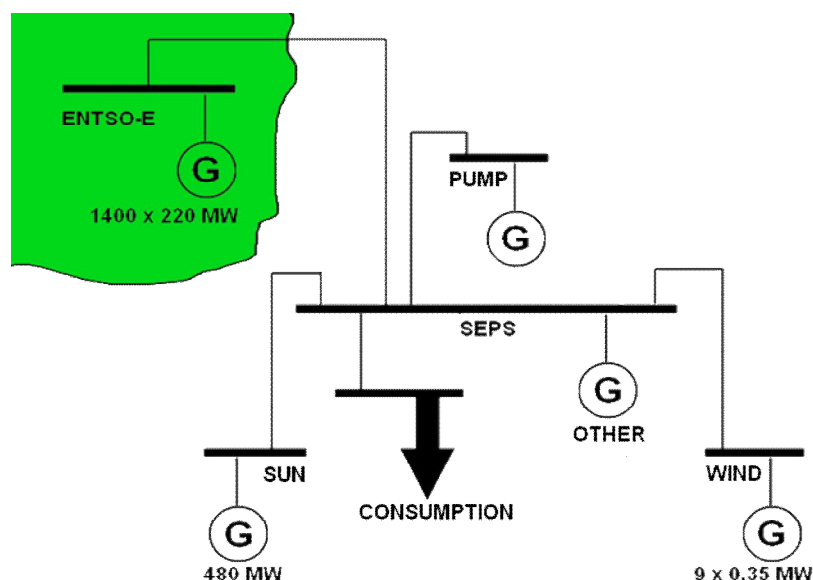


Figure 1- Modelled scheme

All sources type are connected to the node SEPS through power lines. Node CONSUMPTION represents the power system load. Figure 3 compares daily load diagram curve in two cases. First is the year's maximum load (red curve) second is the year's minimum load (blue curve). Results are from year 2010. Year's minimum load is from august when power production from PVPP is maximum, thus the power production is maximum. From figure we can estimate that PV share on total load is about 20%.

The average summer day consumption was chosen as daily load dynamics in modeled scheme. Thus, modeled situation has general dynamic characteristics during summer day in 2010.

All conventional sources (thermal and nuclear power plants) are connected directly to the node SEPS. Number of power generators and power range of the generators are equivalent to real values. Dynamics model of this node is from [1] and [6].

The node ENTSO-E represents the interconnected power system ENTOS-E and it is modelled as one block of 1400 generators each with 200 MW installed power. In terms of dynamic this node represents power system with constant voltage [1].



Figure 2 - Daily load diagram for minimum and maximum year's load

The node WIND represents wind power plants which are connected to the power system. Total installed capacity in wind turbines is in Slovakia only 3.14 MW. Wind turbines are part of model but can be negligible. Table 2 shows all nodes with their preferences and comments.

Table 2 - Nodes used in model

Node name	Load [MW]	Installed Power [MW]	Comment
WIND	0	9 x 0,35	Wind Turbines
SUN	0	480	Photovoltaic Power plants
PUMP	0	1020	Pump storage Power plants
SEPS	0	7100	Slovak Power System equivalent
CONSUMPTION	2700	0	Power system load according to daily load curve
ENTSO-E	5000	1400 x 220	Equivalent of ENTSO-E power system

The PVPP which delivers power to power system are in model connected to the node SUN. As has been sad total installed power capacity in PV is set to 480 MW which is equivalent to real value. PV was in programme MODES modelled as PMGC (permanent magnet generator and frequency converter) generator. Power source model was set to SUNS which is model determined for photovoltaic panels. During long –term dynamic simulation different parameters of this model was used. These different parameters represent different weather conditions. All used models are described in [3], [4], [5] and [7].

Pump storage water power plants which are connected to tertiary real power regulation are connected to the node PUMP.

3. LONG-TERM DYNAMIC SIMULATION

The influence of PVPP on long-term dynamics is modelled in programme MODES. Dynamic simulation time is set to 24 hours (86400 seconds). During the simulation sampling period was set to 600 seconds.

The case follows from planned cross-border power balance which is set to the 100 MW. Central controller maintains nominal frequency value and planned cross-border balance value. Output results from MODES are graphically showed in following figures.

Whole simulation is divided to two main cases.

- Case 1 – sunny day
- Case 2 – cloudy day

In the first case sunny summer weather is simulated during whole day (24h). Thus this delivered energy from PVPP depends only on the intensity and terminal angle of solar radiation. This case represents blue curve. In second case the cloudy summer weather is modelled. This case represents the cloudy weather when clouds are crossing the sun and causes power delivery deviations in PVPP. This case represents red curve. Results are shown in figure 3.

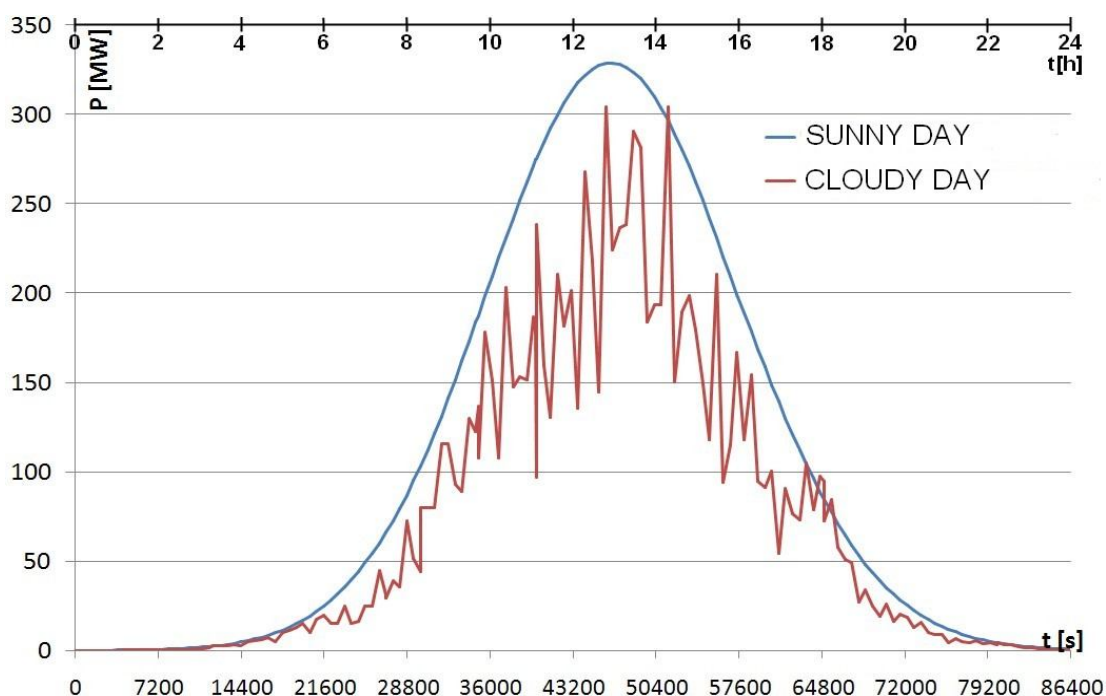


Figure 3 - Power delivery from PV power plants

We can see sharp deviations caused by clouds during the cloudy weather conditions. These deviations are significant and in some cases during the day reach value of 150 MW. This phenomenon occurs during the peak of daily load. These significant power deviations may in some cases cause power system instability. The deviation is also shown in central controller output (Figure 4). Figure 4 compares central controller regulation process in Slovak power system. The controller maintains system frequency and cross-border balance values. During the sunny day the controller regulation process (showed as blue curve) has smaller deviations which mean smaller regulation power and more stable operation of power system. During the cloudy weather the controller's output deviations are more significant and sharp. This is caused by clouds which decrease the solar radiation and thus decrease the power produced by PV power plants. All these power deviations in power system have to be offset by another energy sources.

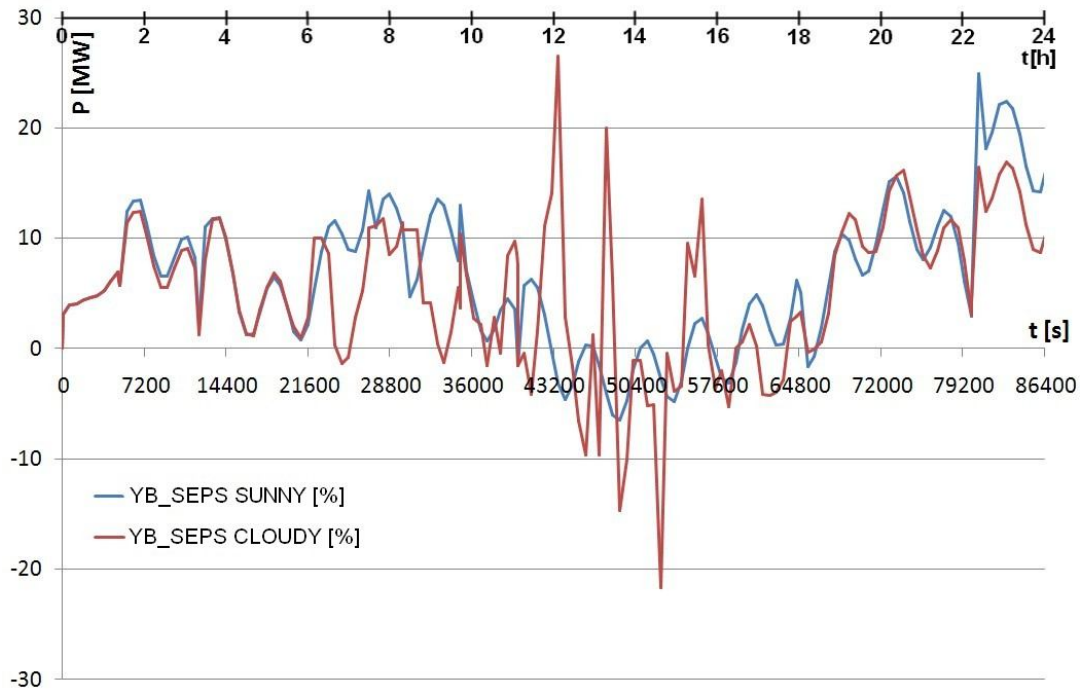


Figure 4 – Central controller output

Figure 5 compares cross-border balance planned value which is set to 100 MW (showed as black line) with real power transmitted trough inter tie line during sunny (blue curve) and cloudy (red curve) weather conditions.

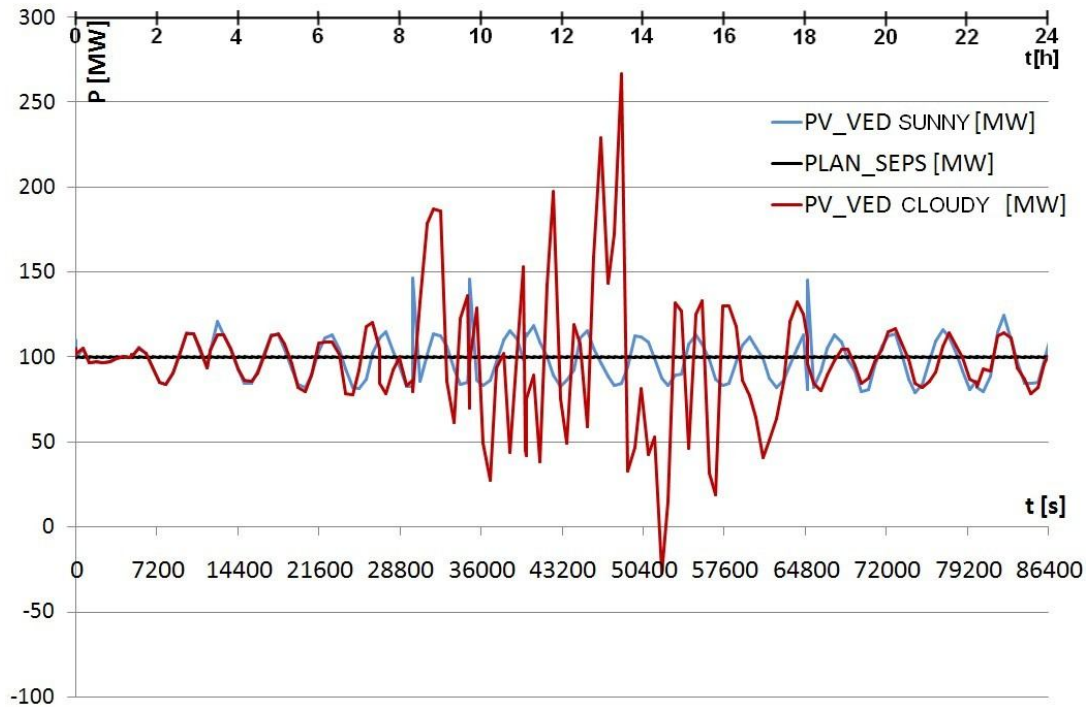


Figure 5 - Cross-border balance value for both cases

Both curves are until time circa 30 000 seconds (about 8 hours) very similar. At time circa 40 000 cloudy weather causes fast and significant changes in PVPP power production. This changes causes big deviations in power transmitted trough inter tie line. As figure shows, deviations during cloudy weather can be more than 150 MW in comparison with planned value.

5. CONCLUSIONS

Paper describes influence of RES on long-term dynamics in Slovak power system. The 24 hours simulation shows power production of RES especially PV power plants during two different weather conditions. This simulations shows the influence of RES during the average summer day when is the share of power production from RES in power system largest. This large share may during bad weather conditions causes big power balance deviations, changes in cross-border balance and in some specific cases instability in power system. This state is caused by significant growth of RES in Slovak power system. If this trend will continue, the unpredictable sources connected to the power system may cause bigger deviations or instability in power system.

REW was in programme MODES modelled as one central power source with 480 MW of total installed power. This source represents all PVPP which are connected to the power system in Slovakia in 2010. This paper refers the influence of RES as unpredictable power source on power system.

REFERENCES

- [1] *K. Máslo, M. Pistora*: Long term dynamics modelling of renewable energy sources, IEEE EUROCON International Conference on Computer as a Tool, Lisabon, Portugal, 2011, ISBN 978-1-4244-7485-1
- [2] *Máslo K, Pistora M.*: Modeling of cooperation of embedded generation in smart grids, ELEN conference, Prague, Czech Republic, 2010
- [3] *K. Máslo*: Influence of wind farms on transmission system operation in the central Europe, the 9th International Conference Control of Power Systems, Tatranské Matliare, Slovakia, 2010,, ISBN 978-80-89409-19-9
- [4] *K. Máslo*: Advanced analysis of power system disturbances by the network simulator, the 9th Int. scientific conference Electric Power Engineering, Brno, Czech Republic, 2008, ISBN 978-80-214-3650-3
- [5] *Veleba, J., Martínek, Z.*: Flicker Perceptibility Analysis for Photovoltaic Power Sources in Distribution Networks. Proceedings of the 12th international Scientific Conference EPE 2011, Electric Power Engineering 2011, 17.- 19.5. 2011 hotel Dlouhé Stráně, Kouty nad Desnou, Czech Republic, VSB – Technical University of Ostrava, IEEE, ISBN 978-80-248-2393-5
- [6] *Hejtmankova P., Skorpil J., Dvorsky E.*: The Czech Republic Possibilities in Utilization of Renewable Power Sources. In IEEE/PES Transmission and Distribution Conference and Exposition – Latin America, Bogota, COLOMBIA, 2008, ISBN 978-1-4244-2218-0
- [7] *Dvorsky E., Hejtmankova P., Scerba E, et al.*: Modeling of PV systems. Solar World Congress of the International-Solar-Energy-Society, Bering, PEOPLES REPUBLIC CHINA, 2007, ISBN 978-3-540-75996-6
- [8] *MH SR*: Návrh analýzy systému podpory obnoviteľných zdrojov energie a návrh na jeho prehodnotenie - nové znenie, UV-15850/2011

ACKNOWLEDGEMENT

This publication is the result of the Project implementation: Research centre for efficient integration of the renewable energy sources, ITMS: 26220220064 supported by the Research & Development Operational Programme funded by the ERDF.



We support research activities in Slovakia / Project is co financed from EU funds.

Tel.: +421 55 602 3560

Ing. Jaroslav Petráš, PhD
Technical University of Kosice
Department of Electric Power Engineering
Mäsiarska 74, 041 20 Košice, Slovakia
E-mail: jarosla.petras@tuke.sk
Tel.: +421 55 602 3564

Ing. Matúš Novák
Technical University of Kosice
Department of Electric Power Engineering
Mäsiarska 74, 041 20 Košice, Slovakia
E-mail: matus.novak@tuke.sk
Tel.: +421 55 602 3560

Ing. Jan Zbojovský
Technical University of Kosice
Department of Electric Power Engineering
Mäsiarska 74, 041 20 Košice, Slovakia
E-mail: jan.zbojovsky@tuke.sk
Tel.: +421 55 602 3562